

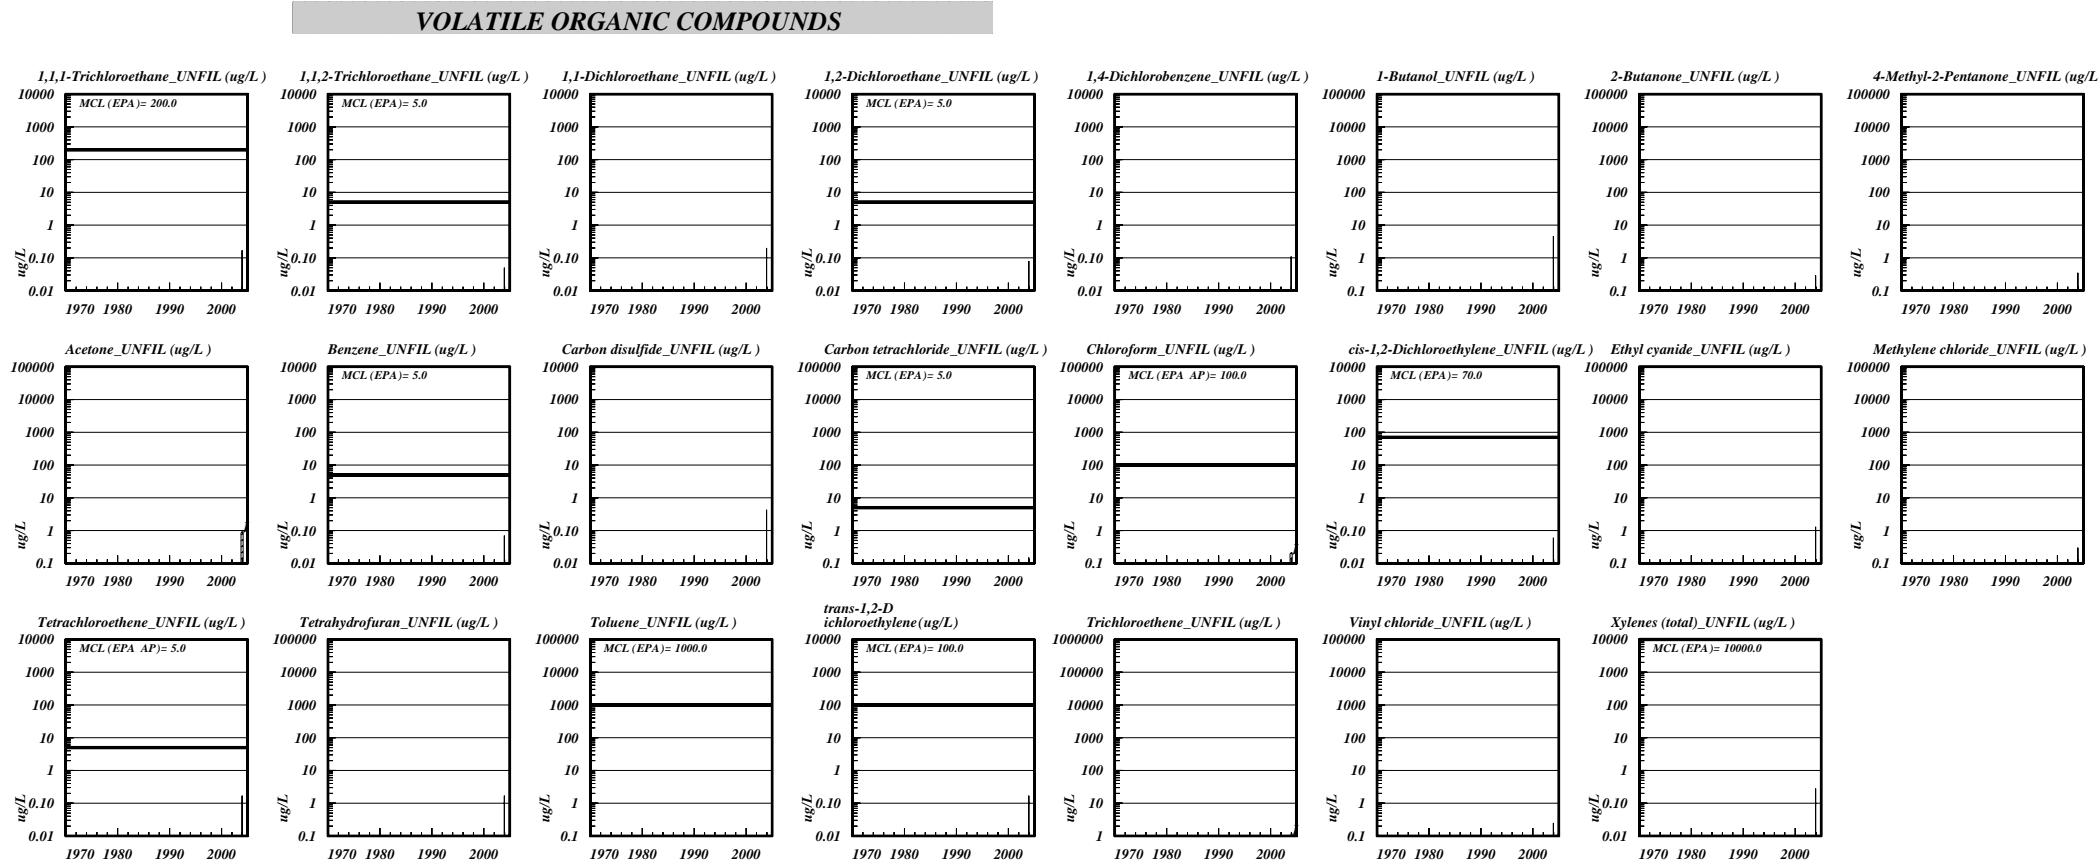


DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-0-99 WELL#=06-D



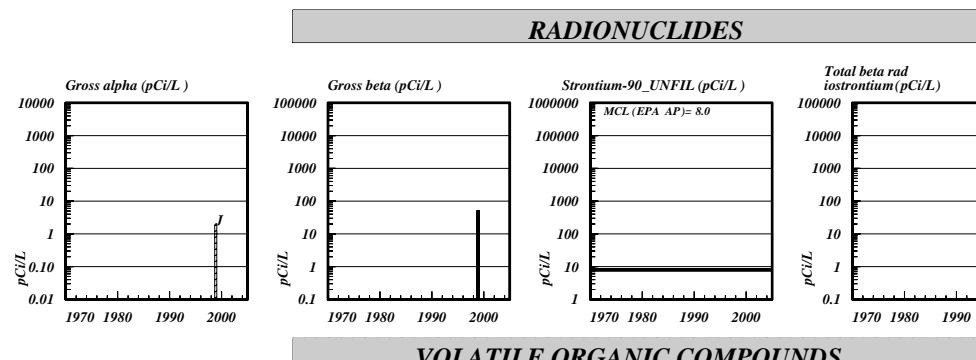


SEMI-VOLATILE ORGANIC COMPOUNDS NO DATA AVAILABLE

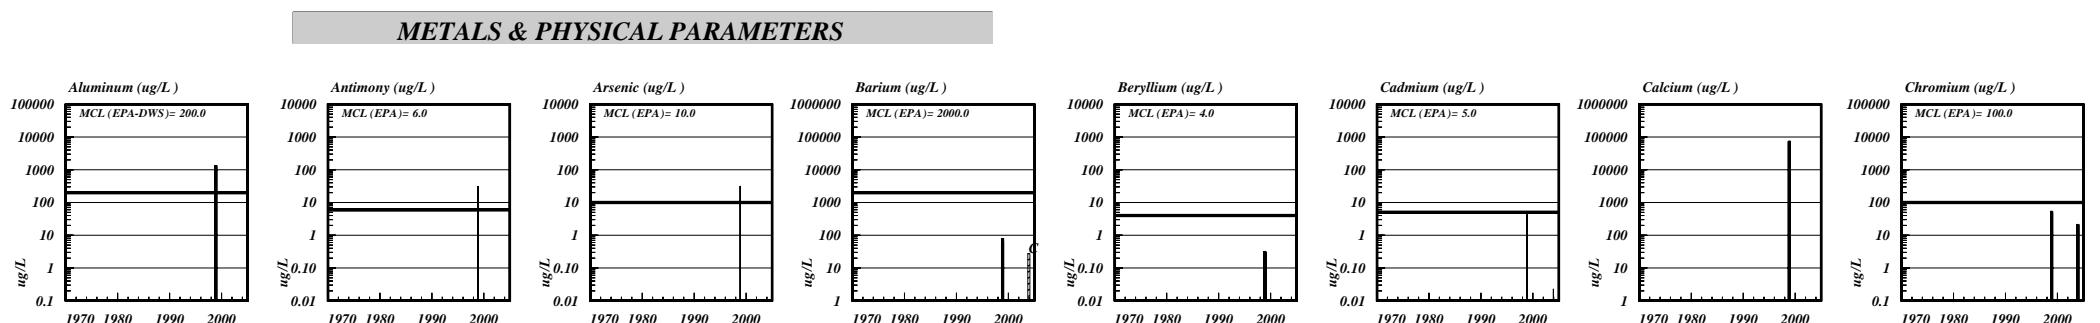

LABORATORY QUALIFIER FLAGS in HEIS are *; >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code;

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

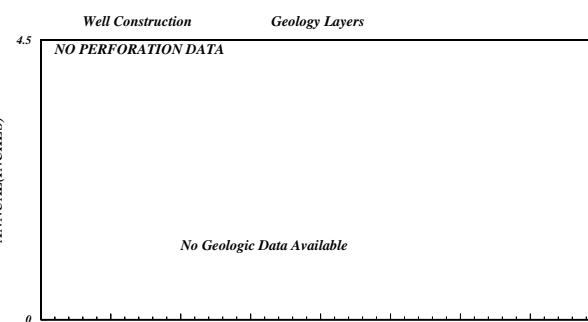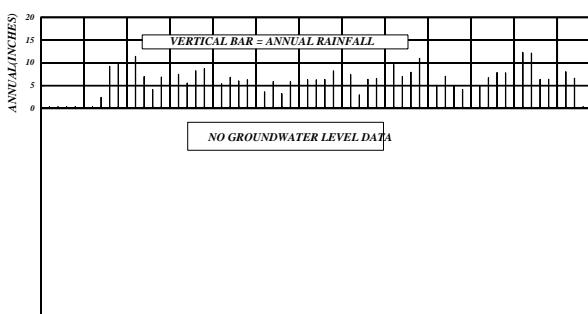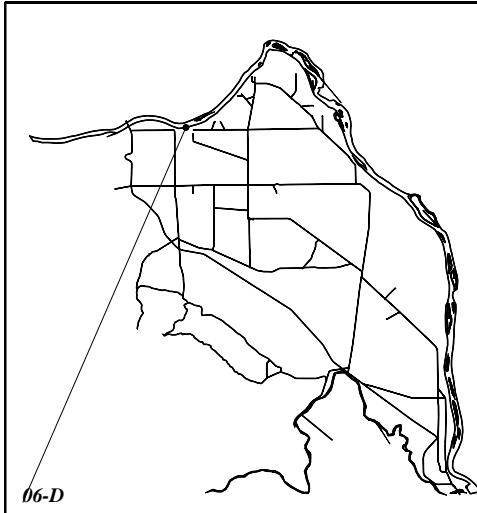


WELLNAME=06-D WELLID=B8128

Well Type=STANDARD Well purpose=AQUIFER TUBE
Owner=DOE Contact Peterson, Roger Compliance=VARIANCE
X_coor= 565294.00 Y_coor= 145412.10 Datum=NAD83(91) Date Survey= 12/8/1997
Well_Comment= Port Identifier 06-D; BHI-01153

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS


wellseries-0-99 WELL#=06-D

METALS & PHYSICAL PARAMETERS

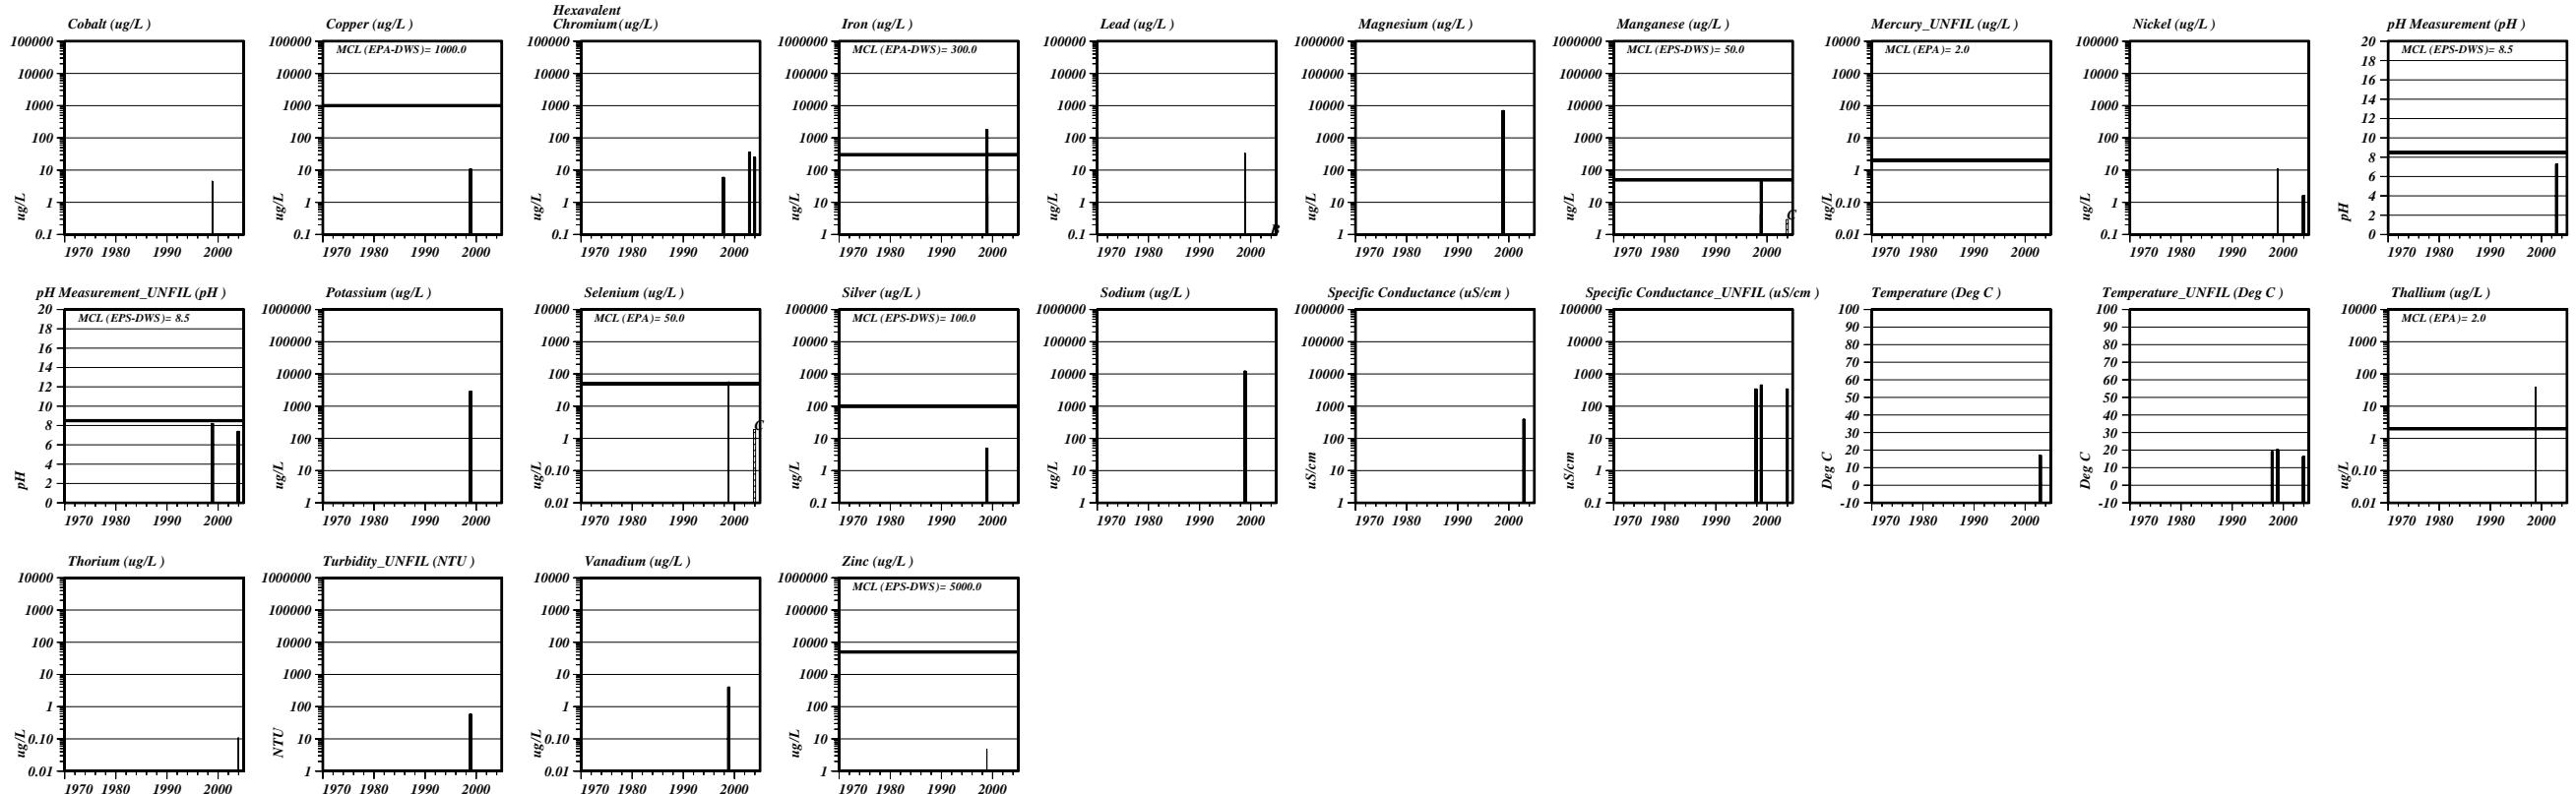

PEST/PCB, HERB, & DIOXINS NO DATA AVAILABLE

GENCHEM & ORGANICS & GENORGANICS

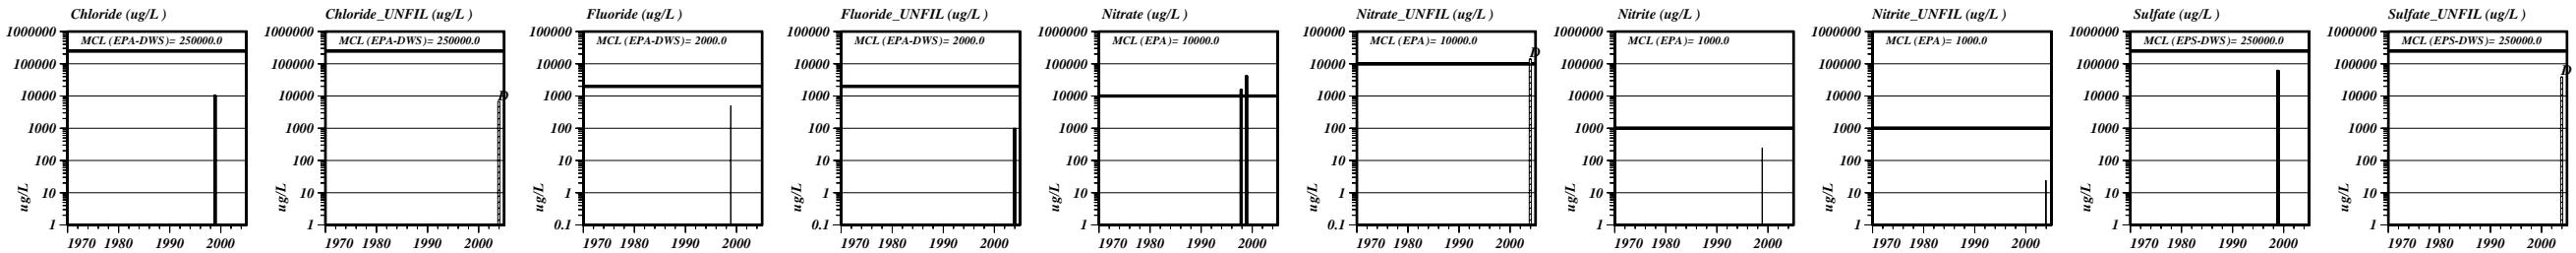

LABORATORY QUALIFIER FLAGS in HEIS are *, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag